

Supplementary information 4

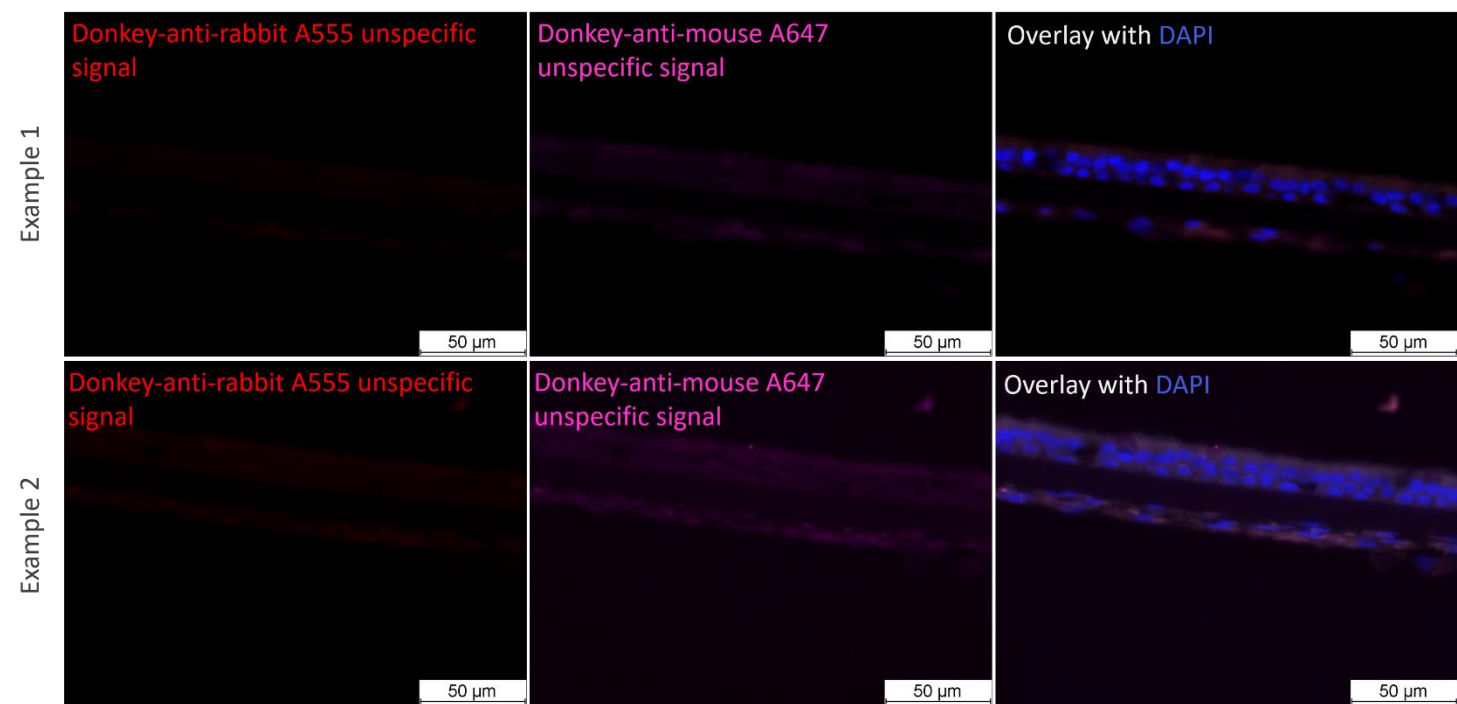


Figure S14: Immunofluorescence negative controls with secondary antibodies.